




DIMENSIONS



AWARDS

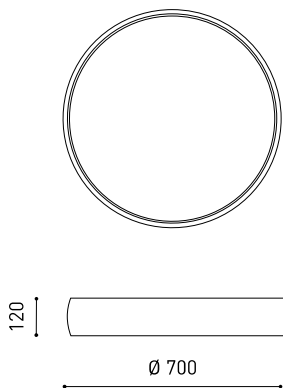

| | |
|-----------|----------------------------|
| Name | DRUM 70 DIM 1/10V 3000K NT |
| Reference | A2391031NT |
| Color | Textured black |
| RAL | 9005 |
| Category | SURFACE |

| | |
|------------------------|------------------|
| Type | LED |
| Gross luminous flux | 8050 lm |
| Colour temperature | 3000 K |
| Chromatic stability | MacAdam Step 2 |
| Colour Rendering Index | CRI > 90 |
| Power | 59,5 W |
| Current | 700 mA |
| Efficacy | 135 lm/W |
| LED lifespan | L80B10 > 60.000h |

| | |
|---------------------|-----|
| Lighting efficiency | 65% |
| Light beam angle | 96° |

| | |
|-----------------------------|----------|
| Driver | Included |
| Power values of the system | 67,03 W |
| Frequency | 50/60 Hz |
| Dimming | 1-10V |
| Electrical insulation class | ⊕ |

| | |
|----------------------|-------------------------------------|
| Sealing | IP20 |
| Wireless control | Please Consult |
| Weight | 10500 g |
| Packaged weight | 11534,3 g |
| Packaging dimensions | 765 x 765 x 150 mm |
| Units per package | 1 |
| Materials | Aluminium / Polymethyl Methacrylate |

PRODUCT

LIGHT SOURCE

LIGHTING FIXTURE | PHOTOMETRIC DATA


LIGHTING FIXTURE | ELECTRICAL DATA

OTHER DATA




A large seized ceiling luminaire offering a major luminous flux, either as surface or as suspended fitting, with the possibility to hang it at any desired height. Drum is dimmable in order to be allowed to adapt the light volume at any time exactly to the specific needs of each application or situation. In terms of forms its design is expressed in a surrounding slightly curved circular strip. Counting with a perfect, homogeneous light diffusion and the attractive illusion of a natural skylight.

POLAR DIAGRAM

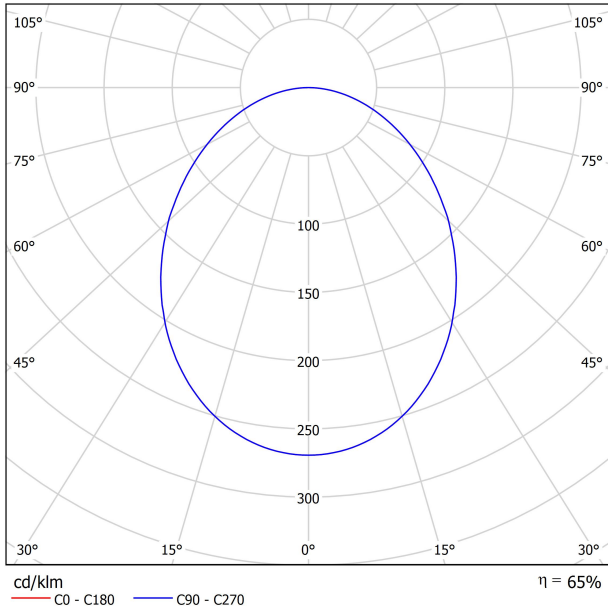

CONICAL DIAGRAM

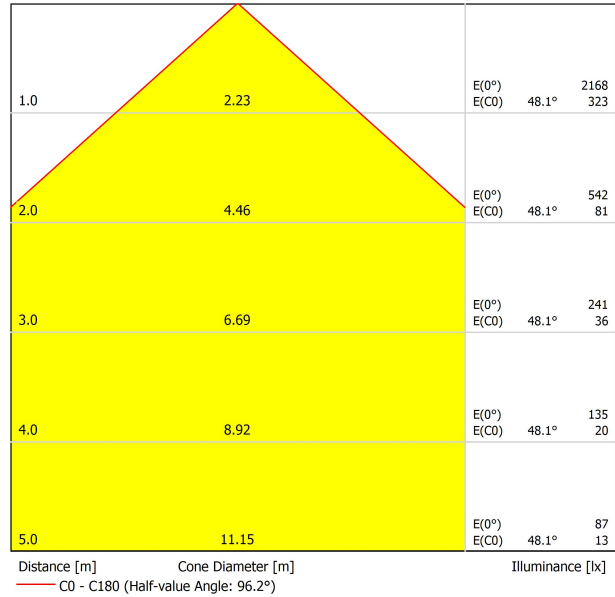

UGR

| Glare Evaluation According to UGR | | | | | | | | | | | |
|--|-----|--|------|------|------|------|---|------|------|------|------|
| Room Size X Y | | Viewing direction at right angles to lamp axis | | | | | Viewing direction parallel to lamp axis | | | | |
| ρ Ceiling | | 70 | 70 | 50 | 50 | 30 | 70 | 70 | 50 | 50 | 30 |
| ρ Walls | | 50 | 30 | 50 | 30 | 30 | 50 | 30 | 50 | 30 | 30 |
| ρ Floor | | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 |
| 2H | 2H | 17.1 | 18.4 | 17.4 | 18.6 | 18.8 | 17.1 | 18.4 | 17.4 | 18.6 | 18.8 |
| | 3H | 18.8 | 19.9 | 19.1 | 20.2 | 20.4 | 18.8 | 19.9 | 19.1 | 20.2 | 20.4 |
| | 4H | 19.4 | 20.5 | 19.8 | 20.8 | 21.1 | 19.4 | 20.5 | 19.8 | 20.8 | 21.1 |
| | 6H | 19.9 | 20.9 | 20.3 | 21.2 | 21.6 | 19.9 | 20.9 | 20.3 | 21.2 | 21.6 |
| | 8H | 20.1 | 21.1 | 20.5 | 21.4 | 21.7 | 20.1 | 21.1 | 20.5 | 21.4 | 21.7 |
| | 12H | 20.2 | 21.2 | 20.6 | 21.5 | 21.8 | 20.2 | 21.2 | 20.6 | 21.5 | 21.8 |
| 4H | 2H | 17.6 | 18.7 | 18.0 | 19.0 | 19.3 | 17.6 | 18.7 | 18.0 | 19.0 | 19.3 |
| | 3H | 19.5 | 20.5 | 19.9 | 20.8 | 21.1 | 19.5 | 20.5 | 19.9 | 20.8 | 21.1 |
| | 4H | 20.4 | 21.2 | 20.7 | 21.5 | 21.9 | 20.4 | 21.2 | 20.7 | 21.5 | 21.9 |
| | 6H | 21.0 | 21.7 | 21.4 | 22.1 | 22.5 | 21.0 | 21.7 | 21.4 | 22.1 | 22.5 |
| | 8H | 21.2 | 21.9 | 21.7 | 22.3 | 22.7 | 21.2 | 21.9 | 21.7 | 22.3 | 22.7 |
| | 12H | 21.4 | 22.0 | 21.9 | 22.4 | 22.9 | 21.4 | 22.0 | 21.9 | 22.4 | 22.9 |
| 8H | 4H | 20.7 | 21.3 | 21.1 | 21.7 | 22.1 | 20.7 | 21.3 | 21.1 | 21.7 | 22.1 |
| | 6H | 21.5 | 22.0 | 21.9 | 22.4 | 22.9 | 21.5 | 22.0 | 21.9 | 22.4 | 22.9 |
| | 8H | 21.8 | 22.3 | 22.3 | 22.7 | 23.2 | 21.8 | 22.3 | 22.3 | 22.7 | 23.2 |
| | 12H | 22.1 | 22.5 | 22.5 | 22.9 | 23.4 | 22.1 | 22.5 | 22.5 | 22.9 | 23.4 |
| 12H | 4H | 20.7 | 21.3 | 21.1 | 21.7 | 22.1 | 20.7 | 21.3 | 21.1 | 21.7 | 22.1 |
| | 6H | 21.5 | 22.0 | 22.0 | 22.5 | 22.9 | 21.5 | 22.0 | 22.0 | 22.5 | 22.9 |
| | 8H | 21.9 | 22.3 | 22.4 | 22.8 | 23.3 | 21.9 | 22.3 | 22.4 | 22.8 | 23.3 |
| Variation of the observer position for the luminaire distances S | | | | | | | | | | | |
| S = 1.0H | | +0.1 / -0.1 | | | | | +0.1 / -0.1 | | | | |
| S = 1.5H | | +0.2 / -0.4 | | | | | +0.2 / -0.4 | | | | |
| S = 2.0H | | +0.4 / -0.7 | | | | | +0.4 / -0.7 | | | | |
| Standard table | | BK06 | | | | | BK06 | | | | |
| Correction Summand | | -4.0 | | | | | -4.0 | | | | |
| Corrected Glare Indices referring to 8050lm Total Luminous Flux | | | | | | | | | | | |



Fuente de luz (LED) reemplazable por un profesional autorizado
 Replaceable (LED only) light source by an authorized professional.
 Source lumineuse (LED) remplaçable par un professionnel agréé
 Sorgente luminosa (LED) sostituibile da parte di un professionista autorizzato
 Austauschbare (LED) Lichtquelle durch einen autorisierten Fachmann



Equipo de control reemplazable por un profesional autorizado
 Replaceable control gear by an authorized professional
 Dispositif de commande remplaçable par un professionnel agréé
 Alimentatore sostituibile da parte di un professionista autorizzato
 Auswechselbares Betriebsgerät durch autorisierten Fachmann

INSTRUCCIONES PARA EL FINAL DE VIDA Y LA ELIMINACIÓN LOS COMPONENTES
 INSTRUCTIONS ON END-OF-LIFE AND COMPONENT DISPOSAL
 INSTRUCTIONS POUR LA GESTION DES COMPOSANTS EN FIN DE VIE ET LEUR MISE AU REBUT
 ISTRUZIONI PER IL FINE VITA E LO SMALTIMENTO DEI COMPONENTI
 ANWEISUNGEN ZUR ENTSORGUNG DER LEUCHTENKOMPONENTEN



Interrumpir la alimentación del aparato
 Cut the power supply to the luminaire
 Couper l'alimentation du luminaire
 Interrompere l'alimentazione dell'apparecchio
 Stromversorgung der Leuchte unterbrechen



Quitar la(s) fuente(s) de luz para el desecho
 Remove light source(s) for disposal
 Retirer la (les) source(s) lumineuse(s) pour l'élimination
 Rimuovere la/le sorgente/e di luce per lo smaltimento
 Lichtquelle(n) zur Entsorgung entfernen



Quitar la batería para el desecho
 Remove the battery for decommissioning
 Retirer la batterie pour sa mise au rebut
 Rimuovere la batteria per la dismissione
 Die Batterie ordnungsgemäß entsorgen



Quitar el equipo de control para el desecho
 Remove control gear for disposal
 Retirer le dispositif de commande pour l'élimination
 Rimuovere l'alimentatore per lo smaltimento
 Betriebsgerät zur Entsorgung ausbauen

Enviar los materiales a un centro de recogida RAEE
 Send the materials to a WEEE collection centre
 Envoyer les matériaux dans une déchetterie DEEE
 Inviare i materiali ad un centro di raccolta RAEE
 Die Materialien in einem WEEE-Zentrum entsorgen

