




Dimensions

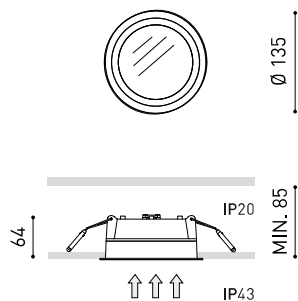

PRODUCT

DEEP MINI 2 DIM PUSH 4000K NT

A2500222NT

Textured black

9005

CEILING RECESSED

LIGHT SOURCE

LED

1075 lm

4000 K

MacAdam Step 2

CRI>90

7 W

500 mA

154 lm/W

L80B10 >60.000h

D

LIGHTING FIXTURE | PHOTOMETRIC DATA

76%

89°

LIGHTING FIXTURE | ELECTRICAL DATA

Included - Connected

9,28 W

50/60 Hz

Push

□

OTHER DATA

IP43

Please Consult

Please Consult

IK07

Ø122 mm

650 g

786,3 g

195 x 160 x 90 mm

1

Aluminium / Polymethyl Methacrylate



Name
Reference
Colour
RAL
Category


Type
Gross luminous flux
Colour temperature
Chromatic stability
Colour Rendering Index
Power
Current
Efficacy
LED lifespan
Energy efficiency class

Lighting efficiency
Light beam angle

Driver
Power values of the system
Frequency
Dimming
Electrical insulation class

Sealing
Wireless control
Emergency power supply
Impact resistance
Recess measurements
Weight
Packaged weight
Packaging dimensions
Units per package
Materials


Polar diagram

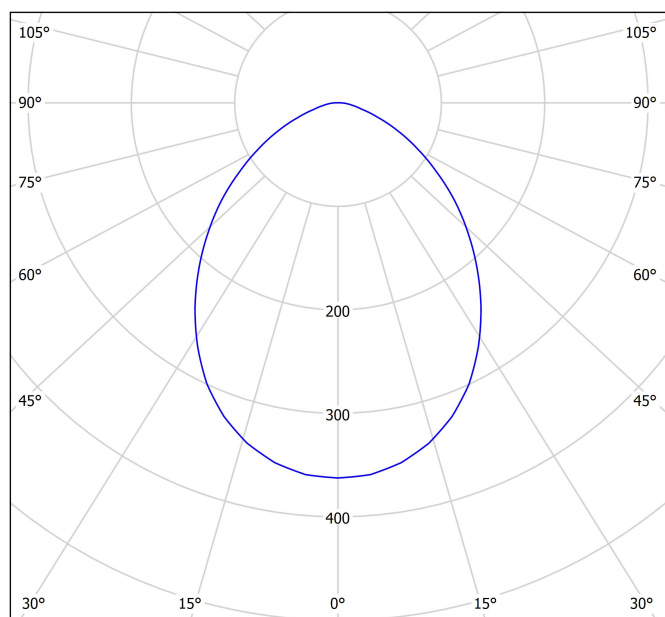

cd/klm
— C0 - C180 — C90 - C270

η = 76%

Conical diagram

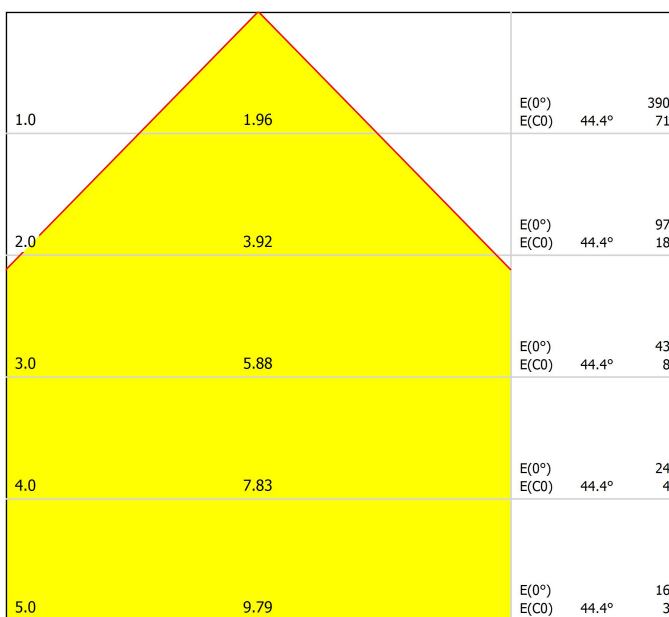

Distance [m] Cone Diameter [m]
— C0 - C180 (Half-value Angle: 88.8°)

Illuminance [lx]

UGR

Glare Evaluation According to UGR

Room Size	X	Y	2H	3H	4H	6H	8H	12H	2H	3H	4H	6H	8H	12H	2H	3H	4H	6H	8H	12H	2H	3H	4H	6H	8H	12H
2H	2H	21.8	22.9	22.0	23.2	23.4	21.8	22.9	22.0	23.2	23.4	21.8	22.9	22.0	23.2	23.4	21.8	22.9	22.0	23.2	23.4	21.8	22.9	22.0	23.2	23.4
3H	3H	22.8	23.9	23.1	24.1	24.4	22.8	23.9	23.1	24.1	24.4	22.8	23.9	23.1	24.1	24.4	22.8	23.9	23.1	24.1	24.4	22.8	23.9	23.1	24.1	24.4
4H	4H	23.1	24.1	23.4	24.3	24.6	23.1	24.1	23.4	24.3	24.6	23.1	24.1	23.4	24.3	24.6	23.1	24.1	23.4	24.3	24.6	23.1	24.1	23.4	24.3	24.6
6H	6H	23.3	24.2	23.6	24.5	24.8	23.3	24.2	23.6	24.5	24.8	23.3	24.2	23.6	24.5	24.8	23.3	24.2	23.6	24.5	24.8	23.3	24.2	23.6	24.5	24.8
8H	8H	23.4	24.2	23.7	24.5	24.9	23.4	24.2	23.7	24.5	24.9	23.4	24.2	23.7	24.5	24.9	23.4	24.2	23.7	24.5	24.9	23.4	24.2	23.7	24.5	24.9
12H	12H	23.4	24.3	23.8	24.6	24.9	23.4	24.3	23.8	24.6	24.9	23.4	24.3	23.8	24.6	24.9	23.4	24.3	23.8	24.6	24.9	23.4	24.3	23.8	24.6	24.9
4H	2H	22.1	23.1	22.5	23.4	23.7	22.1	23.1	22.5	23.4	23.7	22.1	23.1	22.5	23.4	23.7	22.1	23.1	22.5	23.4	23.7	22.1	23.1	22.5	23.4	23.7
3H	3H	23.3	24.2	23.7	24.5	24.8	23.3	24.2	23.7	24.5	24.8	23.3	24.2	23.7	24.5	24.8	23.3	24.2	23.7	24.5	24.8	23.3	24.2	23.7	24.5	24.8
4H	4H	23.7	24.5	24.1	24.8	25.2	23.7	24.5	24.1	24.8	25.2	23.7	24.5	24.1	24.8	25.2	23.7	24.5	24.1	24.8	25.2	23.7	24.5	24.1	24.8	25.2
6H	6H	24.0	24.6	24.4	25.0	25.4	24.0	24.6	24.4	25.0	25.4	24.0	24.6	24.4	25.0	25.4	24.0	24.6	24.4	25.0	25.4	24.0	24.6	24.4	25.0	25.4
8H	8H	24.1	24.7	24.6	25.1	25.5	24.1	24.7	24.6	25.1	25.5	24.1	24.7	24.6	25.1	25.5	24.1	24.7	24.6	25.1	25.5	24.1	24.7	24.6	25.1	25.5
12H	12H	24.3	24.8	24.7	25.2	25.6	24.3	24.8	24.7	25.2	25.6	24.3	24.8	24.7	25.2	25.6	24.3	24.8	24.7	25.2	25.6	24.3	24.8	24.7	25.2	25.6
8H	4H	23.8	24.4	24.3	24.8	25.2	23.8	24.4	24.3	24.8	25.2	23.8	24.4	24.3	24.8	25.2	23.8	24.4	24.3	24.8	25.2	23.8	24.4	24.3	24.8	25.2
6H	6H	24.2	24.7	24.7	25.1	25.6	24.2	24.7	24.7	25.1	25.6	24.2	24.7	24.7	25.1	25.6	24.2	24.7	24.7	25.1	25.6	24.2	24.7	24.7	25.1	25.6
8H	8H	24.4	24.8	24.9	25.3	25.8	24.4	24.8	24.9	25.3	25.8	24.4	24.8	24.9	25.3	25.8	24.4	24.8	24.9	25.3	25.8	24.4	24.8	24.9	25.3	25.8
12H	12H	24.6	25.0	25.1	25.5	26.0	24.6	25.0	25.1	25.5	26.0	24.6	25.0	25.1	25.5	26.0	24.6	25.0	25.1	25.5	26.0	24.6	25.0	25.1	25.5	26.0
12H	4H	23.8	24.4	24.3	24.8	25.2	23.8	24.4	24.3	24.8	25.2	23.8	24.4	24.3	24.8	25.2	23.8	24.4	24.3	24.8	25.2	23.8	24.4	24.3	24.8	25.2
6H	6H	24.3	24.7	24.7	25.1	25.6	24.3	24.7	24.7	25.1	25.6	24.3	24.7	24.7	25.1	25.6	24.3	24.7	24.7	25.1	25.6	24.3	24.7	24.7	25.1	25.6
8H	8H	24.5	24.8	25.0	25.3	25.8	24.5	24.8	25.0	25.3	25.8	24.5	24.8	25.0	25.3	25.8	24.5	24.8	25.0	25.3	25.8	24.5	24.8	25.0	25.3	25.8

Variation of the observer position for the luminaire distances S

S = 1.0H	+0.2 / -0.3	+0.2 / -0.3
S = 1.5H	+0.4 / -0.8	+0.4 / -0.8
S = 2.0H	+1.0 / -1.5	+1.0 / -1.5

Standard table	BK03	BK03
Correction Summand	5.8	5.8

Corrected Glare Indices referring to 1075lm Total Luminous Flux



Fuente de luz (LED) reemplazable por un profesional autorizado

Replaceable (LED only) light source by an authorized professional.

Source lumineuse (LED) remplaçable par un professionnel agréé

Sorgente luminosa (LED) sostituibile da parte di un professionista autorizzato

Austauschbare (LED) Lichtquelle durch einen autorisierten Fachmann



Equipo de control reemplazable por un profesional autorizado

Replaceable control gear by an authorized professional

Dispositif de commande remplaçable par un professionnel agréé

Alimentatore sostituibile da parte di un professionista autorizzato

Auswechselbares Betriebsgerät durch autorisierten Fachmann

Instrucciones para el final de vida y la eliminación de los componentes:

Instructions on end-of-life and component disposal:


Instructions pour la gestion des composants en fin de vie et leur mise au rebut :

Istruzioni per il fine vita e lo smaltimento dei componenti:


Anweisungen zur entsorgung der Leuchtenkomponenten:



Interrumpir la alimentación del aparato
Cut the power supply to the luminaire
Couper l'alimentation du luminaire
Interrompere l'alimentazione dell'apparecchio
Stromversorgung der Leuchte unterbrechen



Quitar la(s) fuente(s) de luz para el desecho
Remove light source(s) for disposal
Retirer la (les) source(s) lumineuse(s) pour l'élimination
Rimuovere la/le sorgente/e di luce per lo smaltimento
Lichtquelle(n) zur Entsorgung entfernen



Quitar la batería para el desecho
Remove the battery for decommissioning
Retirer la batterie pour sa mise au rebut
Rimuovere la batteria per la dismissione
Die Batterie ordnungsgemäß entsorgen



Quitar el equipo de control para el desecho
Remove control gear for disposal
Retirer le dispositif de commande pour l'élimination
Rimuovere l'alimentatore per lo smaltimento
Betriebsgerät zur Entsorgung ausbauen

Enviar los materiales a un centro de recogida RAEE
Send the materials to a WEEE collection centre
Envoyer les matériaux dans une déchetterie DEEE
Inviare i materiali ad un centro di raccolta RAEE
Die Materialien in einem WEEE-Zentrum entsorgen

